


Cuadro N° 7

Prueba 2	M1	M2	M3	M4	M5
pH original	9,69	8,31	9,18	8,39	7,53
Sulfato de Aluminio (5%) ppm	150	150	150	150	150
Envifloc (0,01%) ppm	0,05	0,1	0,2	0,4	1
Turbidez	326	12	27	16	7
<i>pH óptimo</i>	<i>7,53</i>	<i>7,53</i>	<i>7,53</i>	<i>7,53</i>	<i>7,53</i>
pH original	5,72	5,7	5,69	5,69	5,69
Sulfato de Aluminio (5%) ppm	150	150	150	150	150
Envifloc (0,01%) ppm	0,05	0,1	0,2	0,4	1
Turbidez	73	71	89	121	63

GRAFICO N° 7

PRUEBA 2

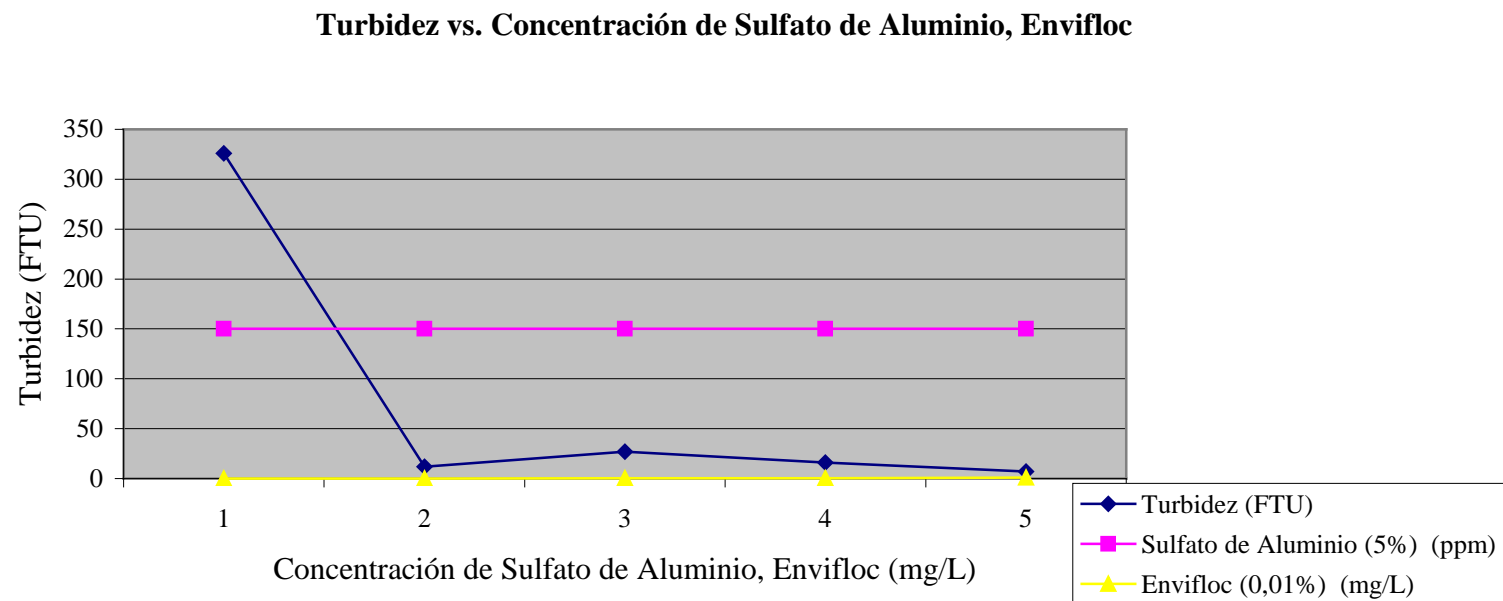

Turbidez vs. Concentración de Sulfato de Aluminio, Envifloc

