


Cuadro N° 5

Prueba 1	M1	M2	M3	M4	M5
pH original	5	6	6,73	8	9
<i>pH óptimo</i>	<i>6,73</i>	<i>6,73</i>	<i>6,73</i>	<i>6,73</i>	<i>6,73</i>
Turbidez (10 min de reposo)	82	13	3	6	10
Turbidez (20 min de reposo)	14	15	4	6	6
Sulfato de Aluminio (5%) ppm	50	100	150	200	250
Envifloc (0,01%) ppm	0,05	0,1	0,15	0,2	0,25

GRÁFICO N° 5

PRUEBA 1

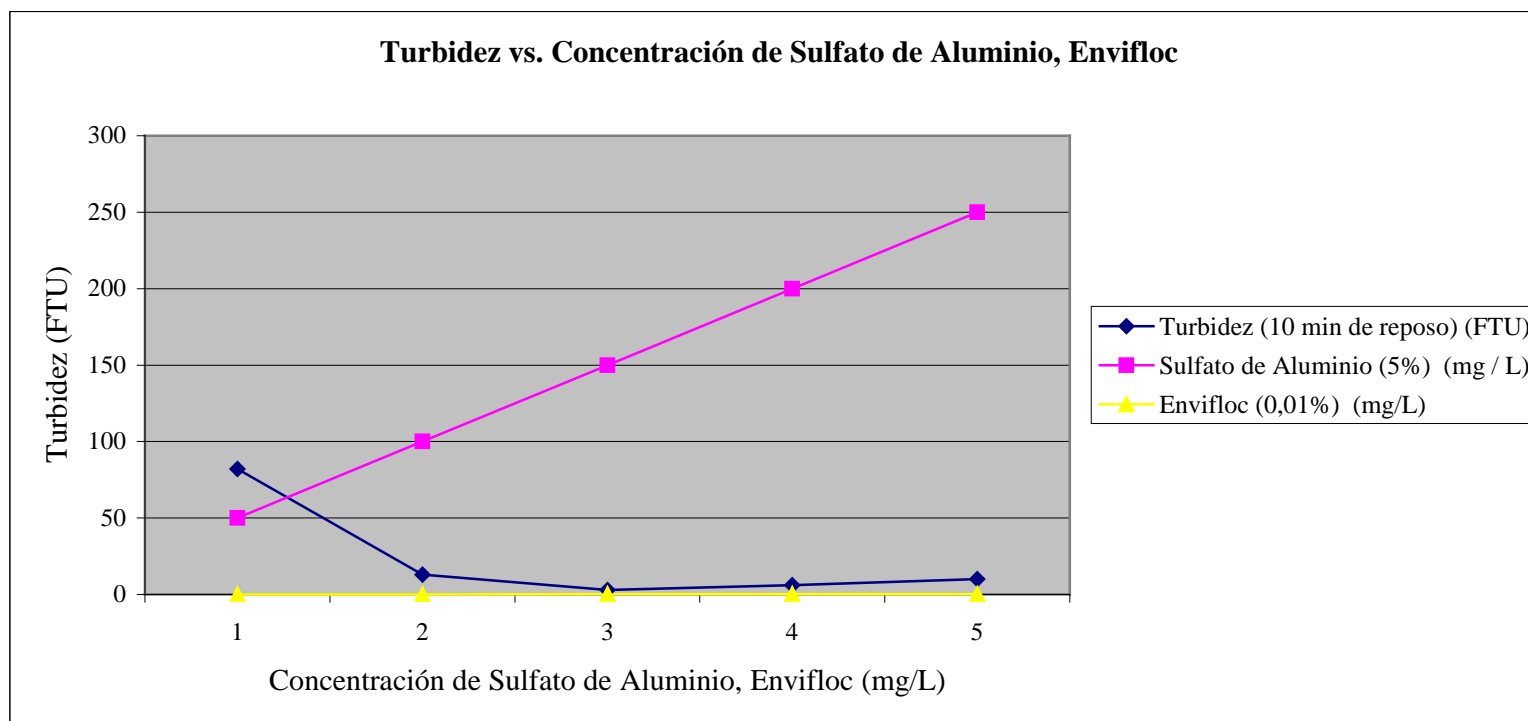

Turbidez vs. Concentración de Sulfato de Aluminio, Envifloc

